Diagram 21 WC cubicle for ambulant disabled people

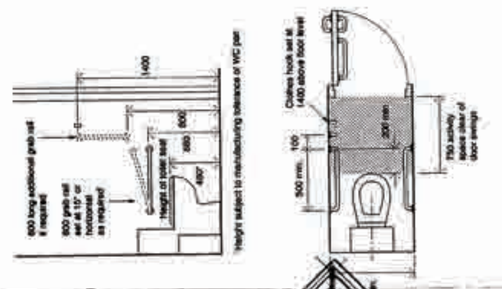

Diagram 12 Internal stairs – key dimensions

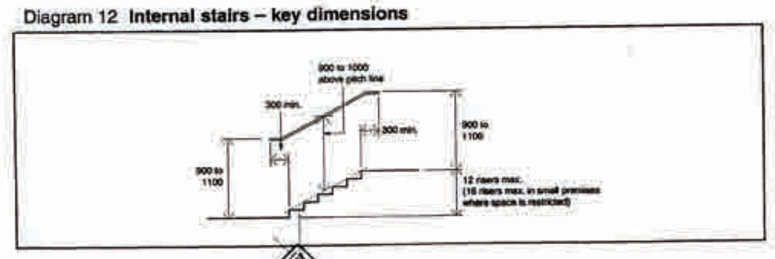

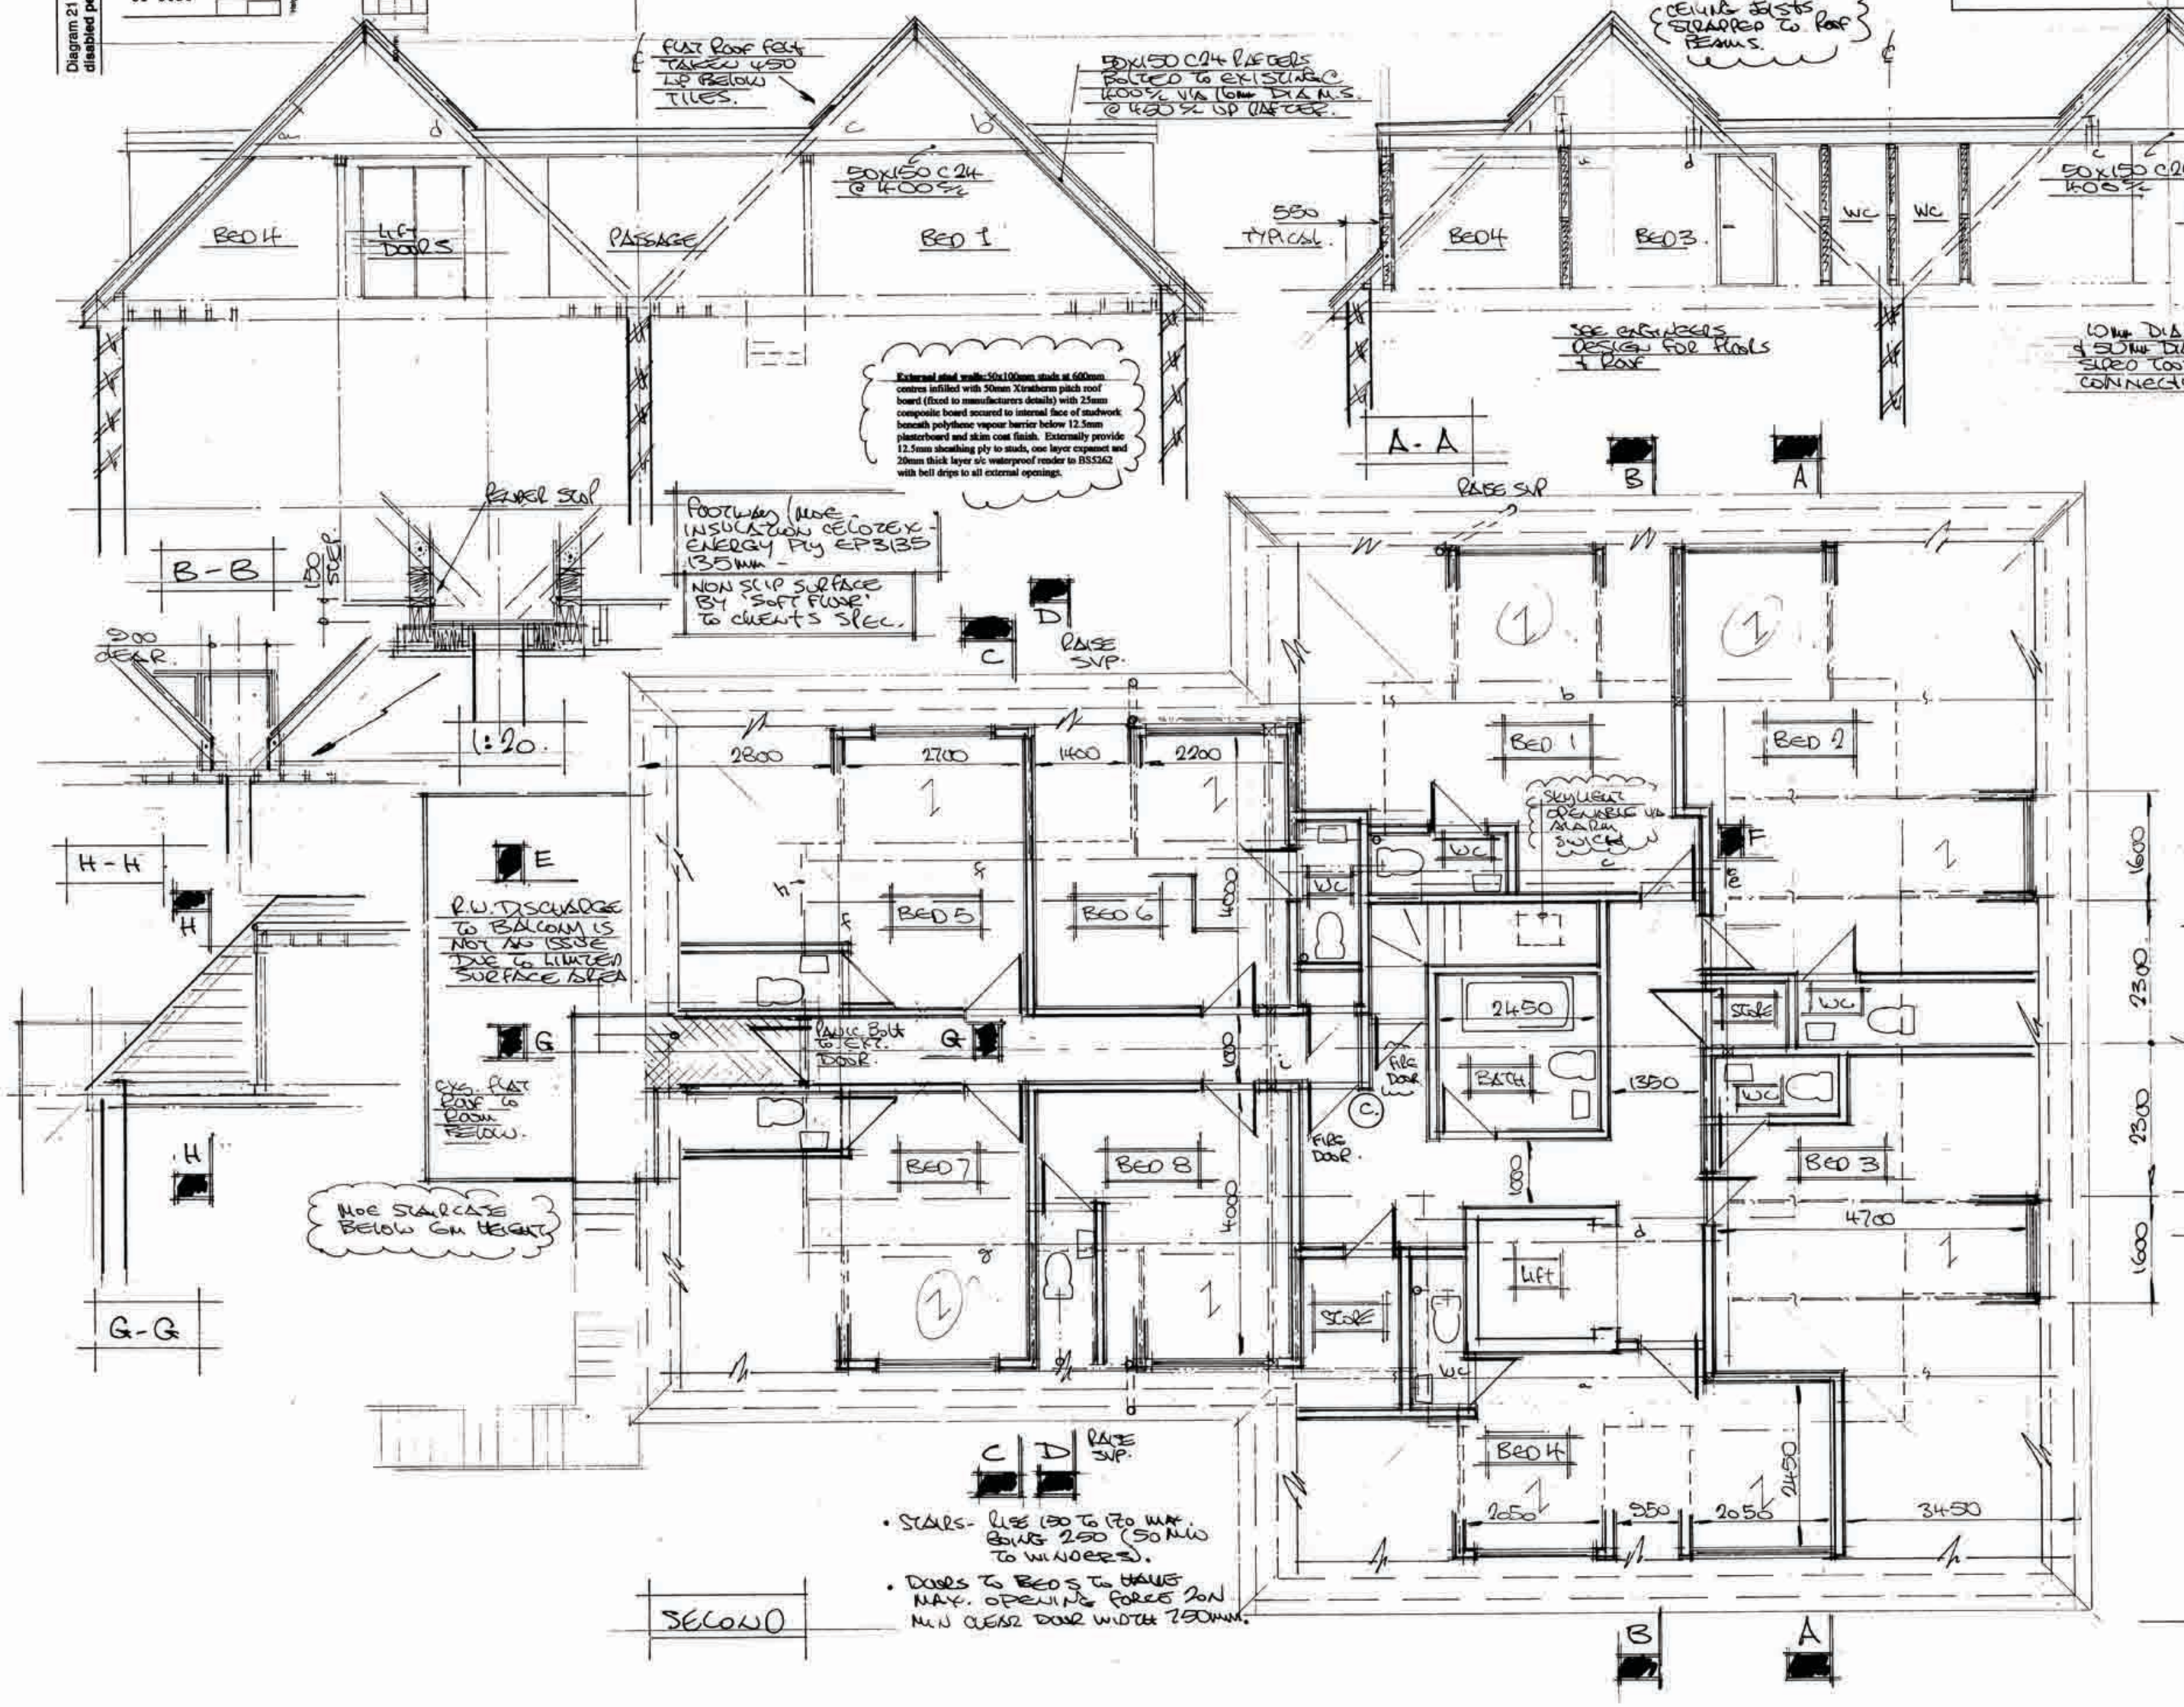

- STAIRS - RISE 150 TO 170 MAX. GOING 250 (50 MIN TO WINDERS).
- DOORS TO BEDS TO HAVE MAX. OPENING FORCE 20N MIN CLEAR DOOR WIDTH 750mm.

(C) PROVIDE EMERGENCY LIGHTING TO BS. 5266: PART 1: 2005 TO ACCESS & ESCAPE ROUTES & WITHOUTLESS SANITARY ACCOMMODATION.
PROVIDE EXIT SIGNAGE TO BS 5499: PART 1: 2002.
FIRE ALARM SYSTEM & SMOKE DETECTION & CALL POINTS TO SPECIALIST CONTRACTORS DESIGN.
CLIENT TO CONFIRM PROPOSALS FOR MEANS OF ESCAPE FOR DISABLED.
FIRE DOORS (NOTED) TO HAVE INTUMESCENT STRIPS / SMOKE SEALS & BE ON SELF CLOSING DEVICES. & F.D.30 DOORS (E)
ELEMENTS OF STRUCTURE TO ACHIEVE 1 HOUR FIRE RESISTANCE.

F WALLS BOUNDING STAIRCASE ENCLOSURE & LIFT SHAFT TO EXTEND INTO ROOF VOID AS FAR AS PRACTICABLE & SEALED WITH VERMICULITE.

E 15 LITRES / SECOND MECHANICAL VENT TO ALL SANITARY ACCOMMODATION LINKED TO LIGHT SWITCH WITH 15 min. OVER RUN PERIOD.

- FIRE ALARM DETAILS TO SPECIALIST DESIGN.
- CARPET PROVIDED TO FLOORS THROUGHOUT.
- HAND BASIN & HOT/COLD WATER PROVISION TO WC CUBICLES FOR DISABLED USE.

Rev	Description	Date
D	B. EGGS	MAR. 08
B	GENL. REVISION	AUG 07
A	GENERAL UPDATE	JULY 07

Rev.	Description	Date
E	B. EGGS	

PROJECT
SECOND FLOOR PLAN

DRG. No. 03	REV: E & D.
1:50	JULY 07

Colin Millard Eng.AMIStruct.E
Unit 5 Barleylands Craft Centre
Barleylands Farm
Billericay
Essex. CM11 2UD
01268 274114 Phone
01268 284960 Fax
07958 217061 Mobile